


**NOTES:**

1. ASSEMBLE PER MANUFACTURER'S RECOMMENDATIONS.
2. ASSEMBLY SHALL BE PRESSURE TESTED AND RATED TO 235 PSI.
3. CURB STOP SHALL BE PLACED 2'-3' (TYP) BEHIND CURB/EDGE OF ROADWAY, OR FROM BACKSIDE OF SIDEWALK.

**LOW PRESSURE FORCED SEWER SERVICE**  
SCALE: N.T.S

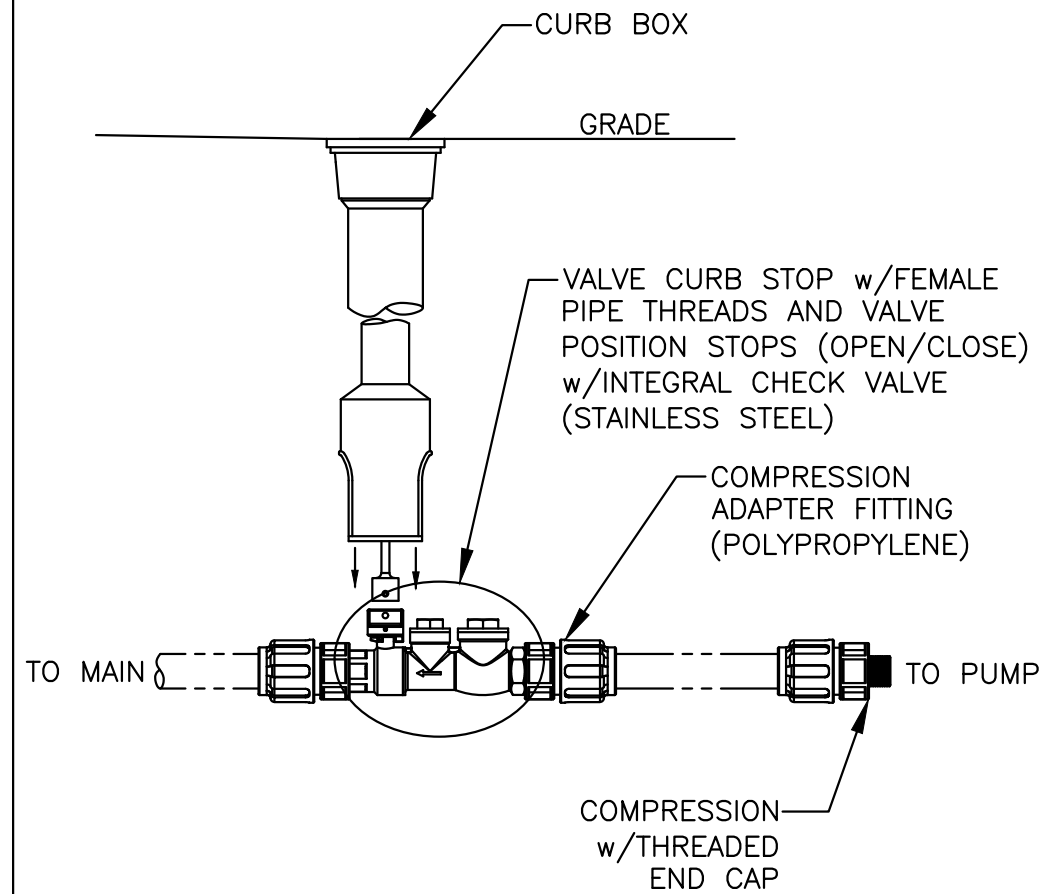

**NOTES:**

1. CURB BOX SHALL BE CAST IRON w/CAST IRON BRASS PENTAGON PLUG. COVER SHALL READ "SEWER".
2. OPERATING ROD SHALL BE STAINLESS STEEL WITH STAINLESS STEEL COTTAR PIN.
3. WHEN CURB BOX IS IN GRASS OR LANDSCAPED AREA, IT SHALL BE SET 2" BELOW GRADE w/#5 REBAR.

**TYPICAL LATERAL KIT**  
SCALE: N.T.S

REFERENCES:  
CITY OF PORTSMOUTH  
STANDARD  
TECHNICAL  
SPECIFICATIONS

DEPARTMENT OF  
PUBLIC WORKS  
CITY OF PORTSMOUTH, NH  
680 PEVERLY HILL ROAD  
603-427-1530



DATE: 05/09/2025  
SCALE: NONE  
PROJ. NO.: N/A  
APVD BY: PHR

PROJECT:  
CITY OF PORTSMOUTH  
STANDARD DETAILS

TITLE:  
LOW PRESSURE FORCED  
SEWER SERVICE

SHEET:  
S-007